


Nato/a:
ID:
Sesso:
Eta':

anni

r-req Vent 83 BPM
Int PR 169 ms
Dur QRS 128 ms
QT/QTc 384/424 ms
Assi P-R-T 28 -40 79
RR Medio 715 ms
QTcB 454 ms
QTcF 429 ms

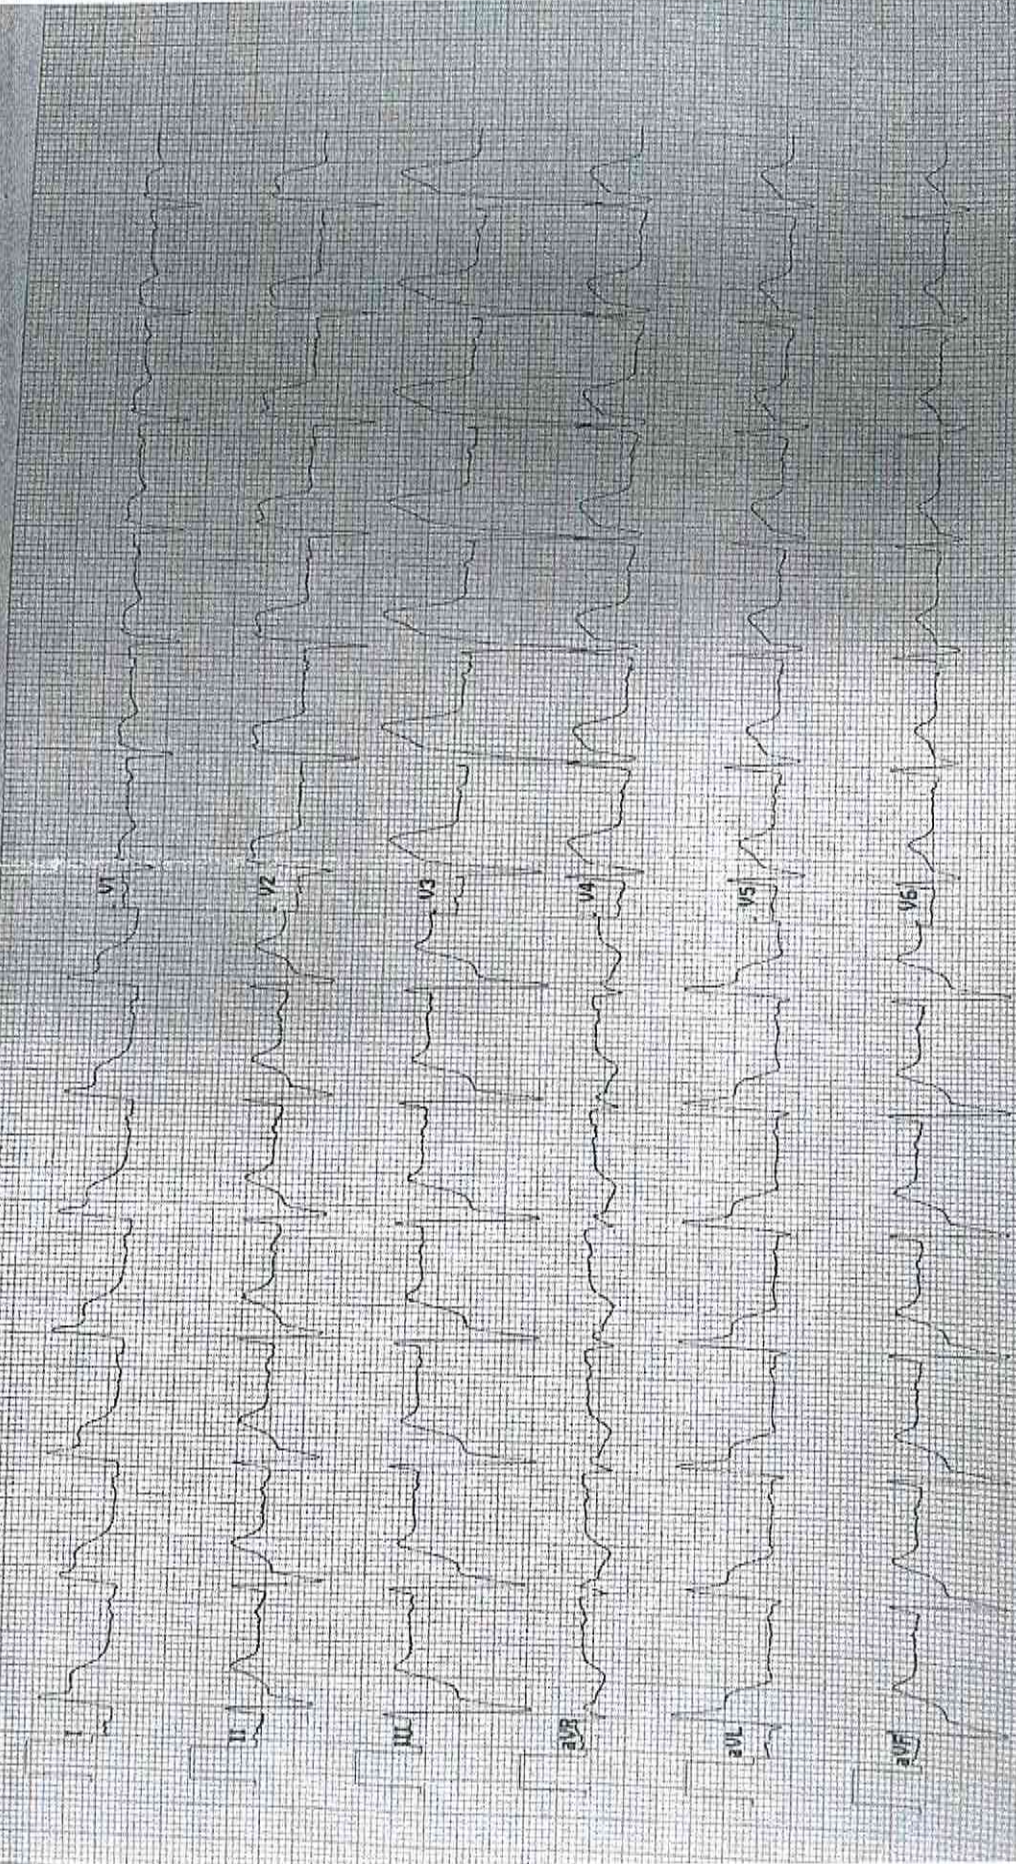

117480597461


Prento 50603050

Sito #1 Card. #0 Vers. 2.3.0 - Sequenza23657 - 25mm/s - 10mm/mV - 0.05 - 150 Hz W

PROVA PRATICA 2



TRONCA PRATICA <

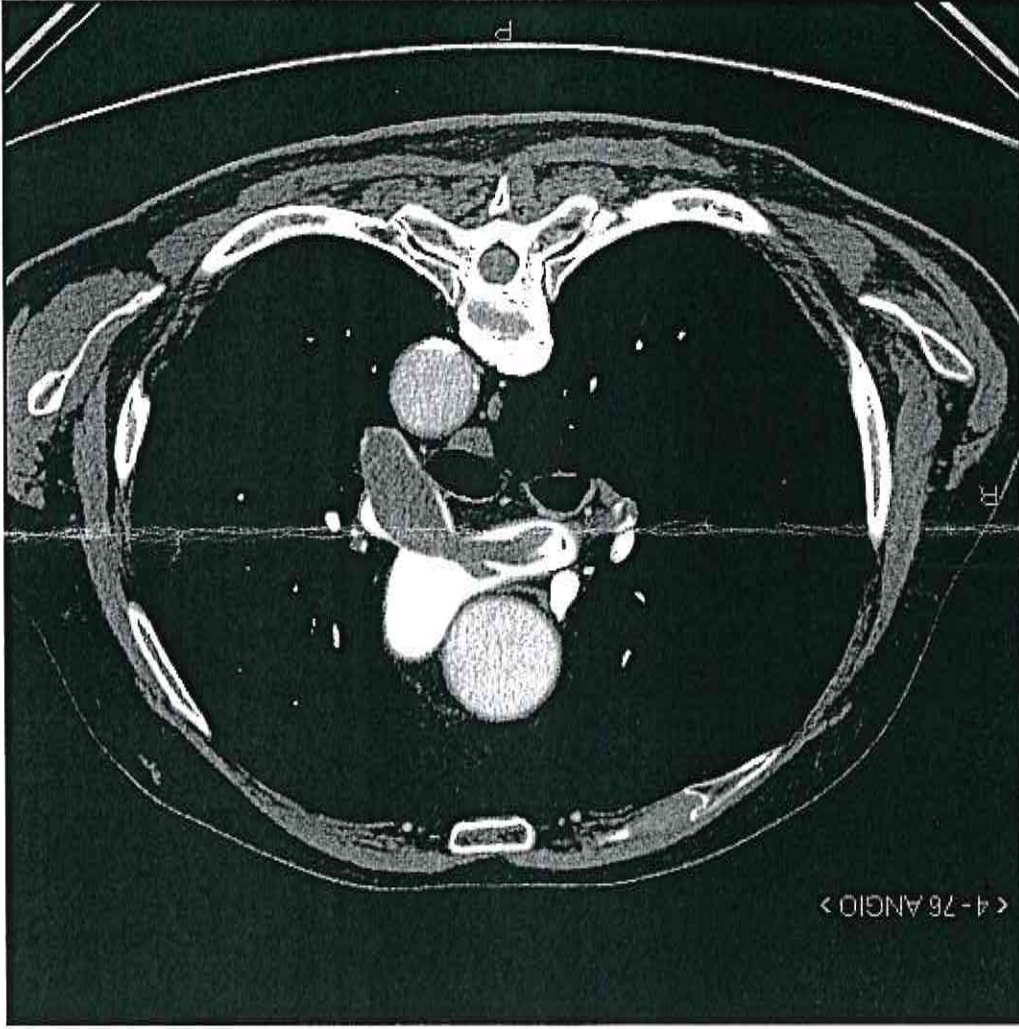

Handwritten signature and a circular stamp. The stamp contains the text 'MENDANA S.' and 'DONAGLIA'.

RAPIDPoint® 500

CAMPIONE ARTERIOSO
 10.06.2023 08:10
 ID sistema 0500-35274



Cognome
 Nome

~~XXXXXXXXXX~~
~~XXXXXXXXXX~~

ACIDO-BASE 37.0 °C

| | | |
|-----------------------------------|---------|--------|
| pH | 7.168 ↓ | |
| pCO ₂ | 71.1 † | mmHg |
| pO ₂ | 89.1 | mmHg |
| HCO ₃ ⁻ act | 25.2 | mmol/L |
| HCO ₃ ⁻ std | 20.9 | mmol/L |
| BE(B) | -4.3 | mmol/L |
| BE(ecf) | -3.3 | mmol/L |
| ctCO ₂ | 27.4 | mmol/L |

CO-OSSIMETRIA

| | | |
|---------------------|--------|------|
| Hct | 33 | % |
| tHb | 11.3 ↓ | g/dL |
| sO ₂ | 95.9 | % |
| FO ₂ Hb | 95.0 | % |
| FCO ₂ Hb | 0.3 ↓ | % |
| FMetHb | 0.6 ↓ | % |
| FHHb | 4.1 | % |

OSSIGENAZIONE 37.0 °C

| | | |
|--|------|--------|
| BO ₂ | 15.6 | mL/dL |
| pO ₂ /F ₁ O ₂ | 3.07 | mmHg/% |

ELETTROLITI

| | | |
|------------------|--------|---------|
| Na ⁺ | 139.5 | mmol/L |
| K ⁺ | 3.57 ↓ | mmol/L |
| Ca ⁺⁺ | 4.2 ↓ | mg/dL |
| Cl ⁻ | 102 | mmol/L |
| AnGap | 15.8 | mmol/L |
| mOsm | 285.6 | mmol/kg |

METABOLITI

| | | |
|-----|-------|--------|
| Glu | 119 † | mg/dL |
| Lac | 1.65 | mmol/L |

F₁O₂ 29.0 %

VALORI NORMALI PAZIENTE

| | |
|------------------|---------------|
| pH | 7.350 - 7.450 |
| pCO ₂ | 35.0 - 45.0 |
| pO ₂ | 80.0 - 100.0 |
| Na ⁺ | 135.0 - 145.0 |
| K ⁺ | 3.60 - 4.80 |
| Ca ⁺⁺ | 4.6 - 5.4 |
| Cl ⁻ | 95 - 105 |
| Glu | 70 - 100 |
| Lac | 0.00 - 1.80 |

| | |
|---------------------|-------------|
| tHb | 12.0 - 16.0 |
| FO ₂ Hb | 0.0 - 96.0 |
| FCO ₂ Hb | 2.0 - 100.0 |
| FMetHb | 1.5 - 100.0 |
| FHHb | 0.0 - 5.0 |

†, ↓ = Fuori range